

Technical Specification

Design Conditions

Standards

Pole Design AS 4676 / AS 1170.2 Sect'n4 / NZS 4203
 Material EN 12767 Class 0 / BS 4360 / BS EN 10025
 Welding (Electric Arc Welding) AS 1554
 Galvanising AS / NZS 4680

Testing Procedures


Dimensional Verification
 Galvanising Thickness
 Material Thickness

Quality Control Procedures

The Supplier/Manufacturer and Galvanizer of the column shall be ISO 9001 : 2000 accredited


Finishing Types

Oven Baked Powder Coated
 High Performance Polyester UV Resistance.
 (formulated for galvanized surface)
 Hot Dip Galvanized
 2 Part Epoxy Coat (10 Years)

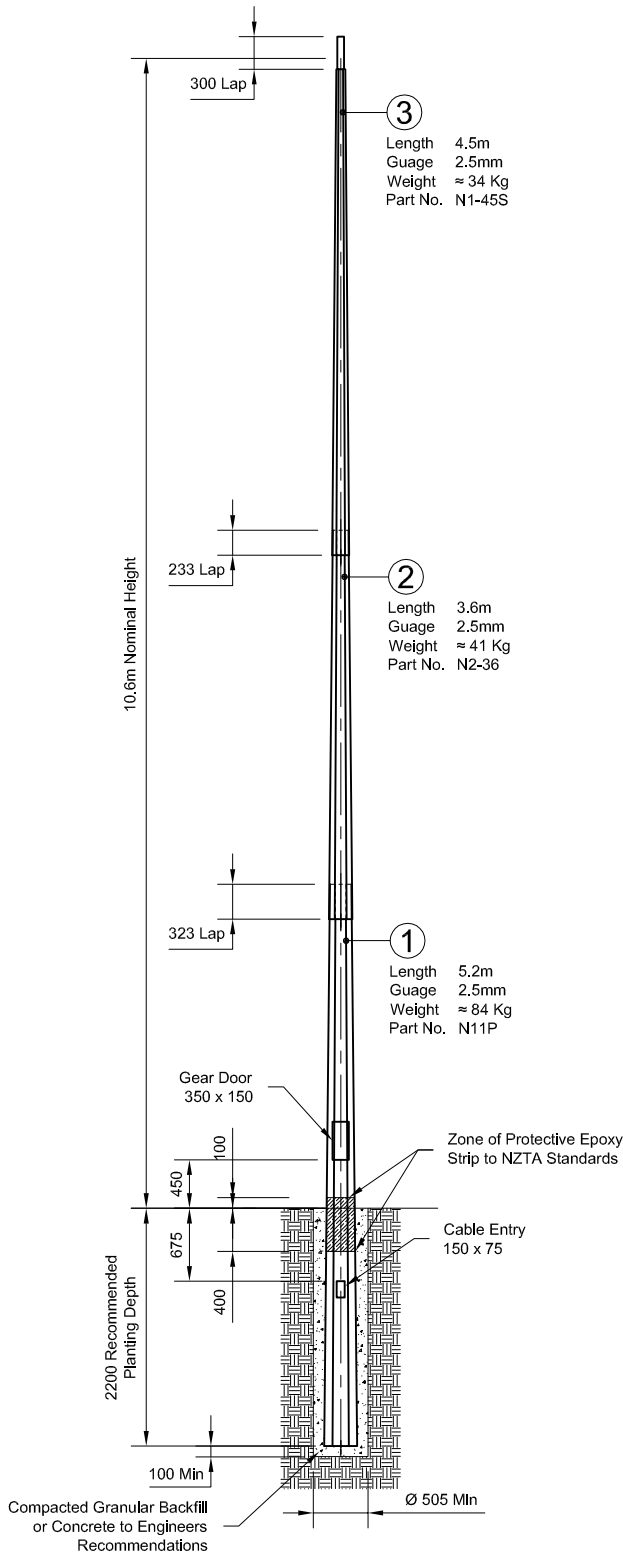

OT-FLD-106-P-1

This drawing and the information contained herein, is the sole property of Steelgal NZ Limited and may not be used without consent from Steelgal NZ Limited.

				Drawn: SMP	Title:	 <p>Steelgal NZ Limited 8 Trugood Drive East Tamaki Auckland P: 0800 736600 P: (+649) 2724665 F: (+649) 2724669 E: sales@steelgal.co.nz W: www.steelgal.co.nz</p>
				Date: 26.07.2010	<p>10.6m Octagonal Streetlight Pole with Planted Base for</p>	
				Scale: NTS		
				Checked:		
A	First Issue	SMP	26.07.2010	Approved:	Drawing Number: OT-FLD-106-P-1	
Rev	Details	By	Chd	Date	Customer:	