

Technical Specification

Standards

Pole Design AS 4676 / AS 1170.2 Sect'n4 / NZS 4203
 Material EN 12767 Class 0 / BS 4360 / BS EN 10025
 Welding (Electric Arc Welding) AS 1554
 Galvanising AS / NZS 4680

Testing Procedures

Dimensional Verification
 Galvanising Thickness
 Material Thickness



Quality Control Procedures

The Supplier/Manufacturer and Galvanizer of the column shall be ISO 9001 : 2000 accredited


Finishing Types

Oven Baked Powder Coated
 High Performance Polyester UV Resistance.
 (formulated for galvanized surface)
 Hot Dip Galvanized
 2 Part Epoxy Coat (10 Years)

SLE Outreach Options

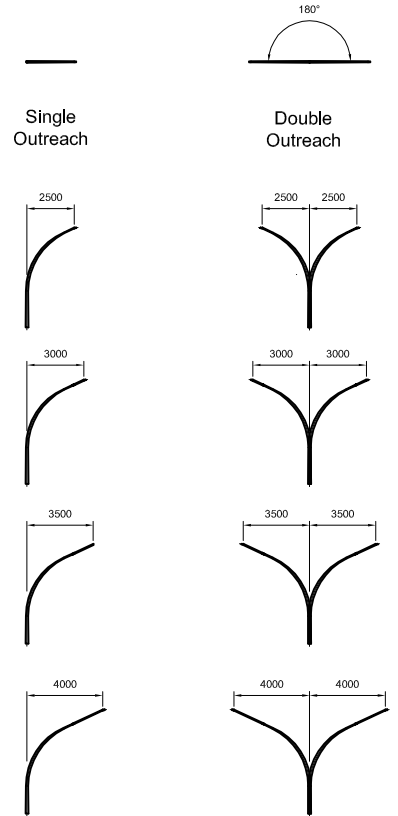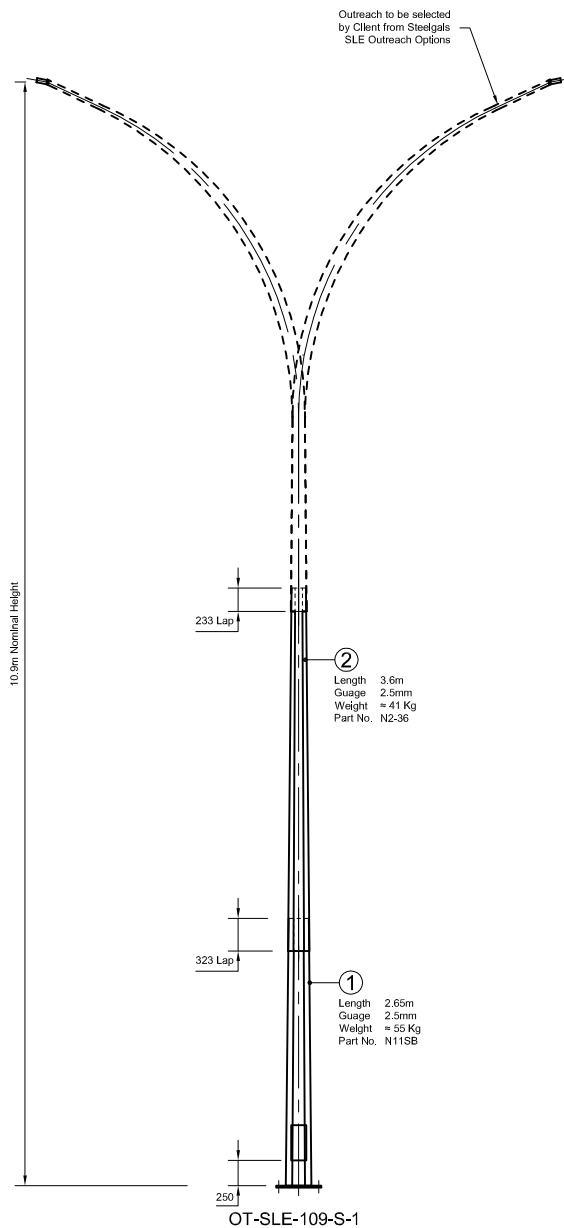

This drawing and the information contained herein, is the sole property of Steelgal NZ Limited and may not be used without consent from Steelgal NZ Limited.

				Drawn: SMP	Title:	 Steelgal NZ Limited 8 Trugood Drive East Tamaki Auckland P: 0800 736600 F: (+649) 2724665 E: sales@steelgal.co.nz W: www.steelgal.co.nz
				Date: 21.07.2010	10.9m Octagonal Streetlight Pole with Shear Base for Elliptical Outreaches	
				Scale: NTS		
				Checked:		
A	First Issue	RY	30.09.2013	Approved:	Drawing Number: OT-SLE-109-S-1	
Rev	Details	By	Chd	Date:	Customer:	