

**Technical Specification**

**Design Conditions**

**Standards**

Pole Design AS 4676 / AS 1170.2 Sect'n4 / NZS 4203  
 Material EN 12767 Class 0 / BS 4360 / BS EN 10025  
 Welding (Electric Arc Welding) AS 1554  
 Galvanising AS / NZS 4680

**Testing Procedures**


Dimensional Verification  
 Galvanising Thickness  
 Material Thickness

**Quality Control Procedures**


The Supplier/Manufacturer and Galvanizer of the column shall be ISO 9001 : 2000 accredited

**Finishing Types**

Oven Baked Powder Coated  
 High Performance Polyester UV Resistance.  
 (formulated for galvanized surface)  
 Hot Dip Galvanized  
 2 Part Epoxy Coat (10 Years)

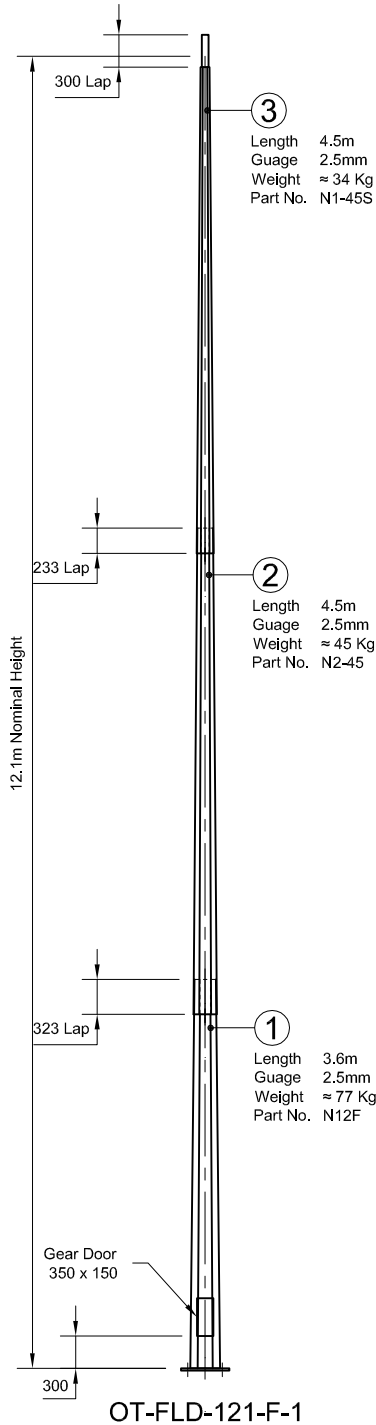

This drawing and the information contained herein, is the sole property of Steelgal NZ Limited and may not be used without consent from Steelgal NZ Limited.

				Drawn: SMP	Title: 12.1m Octagonal Floodlight Pole with Flanged Base		 <p>Steelgal NZ Limited              8 Trugood Drive              East Tamaki Auckland              P: 0800 736600              F: (+649) 2724665              E: sales@steelgal.co.nz              W: www.steelgal.co.nz</p>
				Date: 21.07.2010			
				Scale: NTS			
				Checked:			
A	First Issue	RY	20.09.2013	Approved:	Drawing Number: OT-FLD-121-F-1		
Rev	Details	By	Chd	Date	Customer:		