

Technical Specification

Design Conditions

Standards

Pole Design AS 4676 / AS 1170.2 Sect'n4 / NZS 4203
 Material EN 12767 Class 0 / BS 4360 / BS EN 10025
 Welding (Electric Arc Welding) AS 1554
 Galvanising AS / NZS 4680

Testing Procedures


Dimensional Verification
 Galvanising Thickness
 Material Thickness

Quality Control Procedures

The Supplier/Manufacturer and Galvanizer of the column shall be ISO 9001 : 2000 accredited

Finishing Types

Oven Baked Powder Coated
 High Performance Polyester UV Resistance.
 (formulated for galvanized surface)
 Hot Dip Galvanized
 2 Part Epoxy Coat (10 Years)

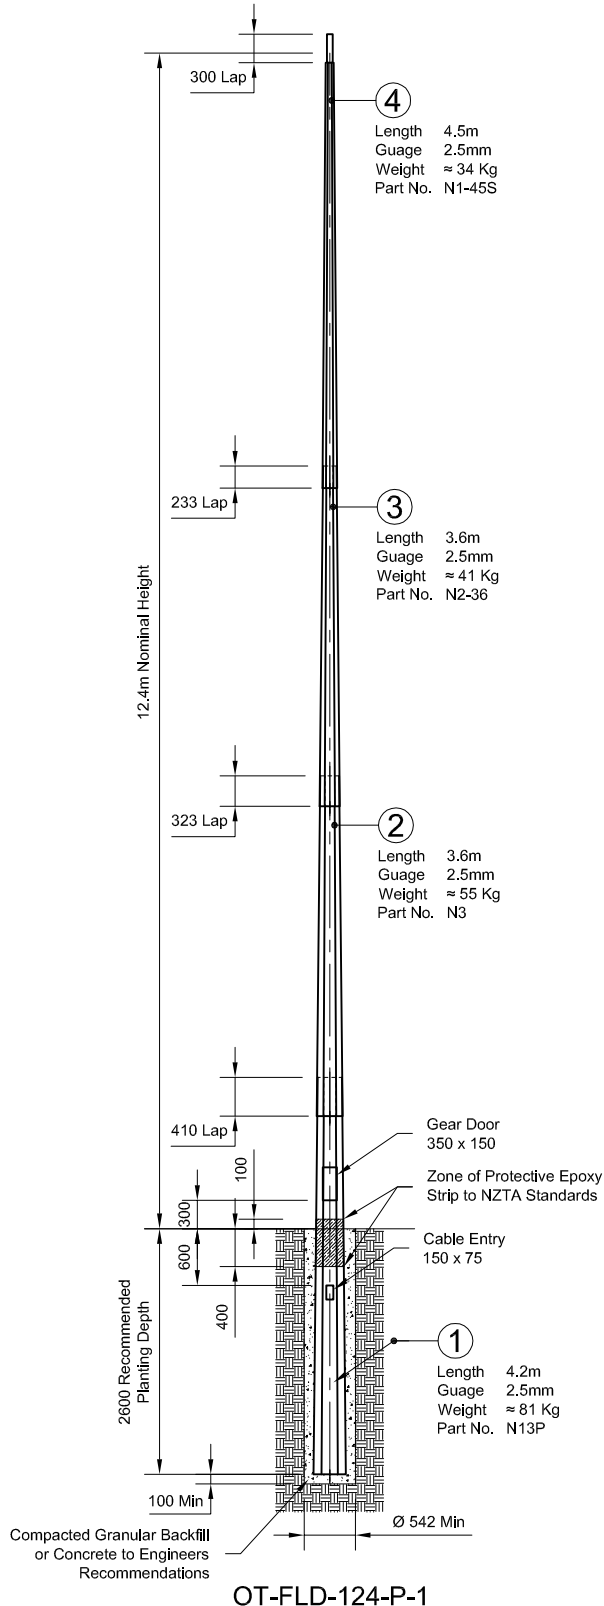

OT-FLD-124-P-1

This drawing and the information contained herein, is the sole property of Steelgal NZ Limited and may not be used without consent from Steelgal NZ Limited.

Drawn:	SMP				
Date:	26.07.2010				
Scale:	NTS				
Checked:					
Approved:					
Date:					
Rev	Details	By	Chd	Date	

Title:	12.4m Octagonal Streetlight Pole with Planted Base
Drawing Number:	OT-FLD-124-P-1
Customer:	



Steelgal Industries
 8 Trugood Drive
 East Tamaki Auckland
 P: 0800 736600
 F: (+649) 2724665
 E: sales@steelgal.co.nz
 W: www.steelgal.co.nz